



INSTRUCTION SHEET

SPEQ ADAPTER REPLACEMENT

689-0752


PAGE 1 OF 1

WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.

RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.


SPEQ-SMALL

- REMOVE (2) SQUARE DRIVE SCREWS

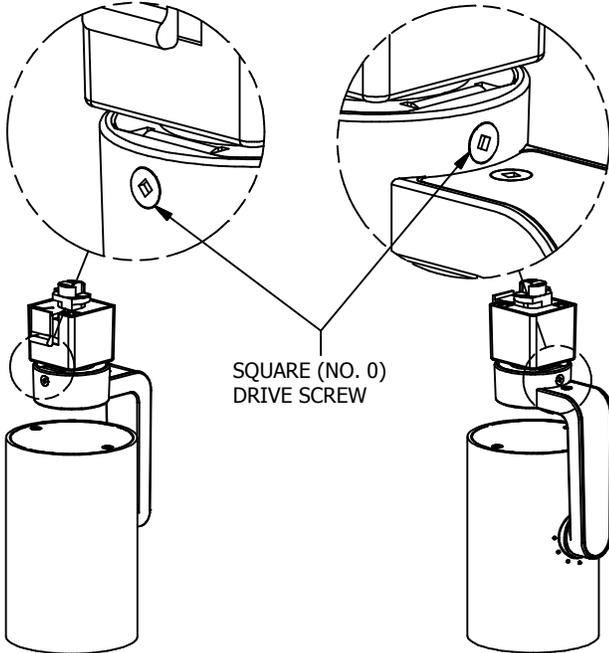

SPEQ-MEDIUM / LARGE

- REMOVE (2) PHILLIPS DRIVE SCREWS

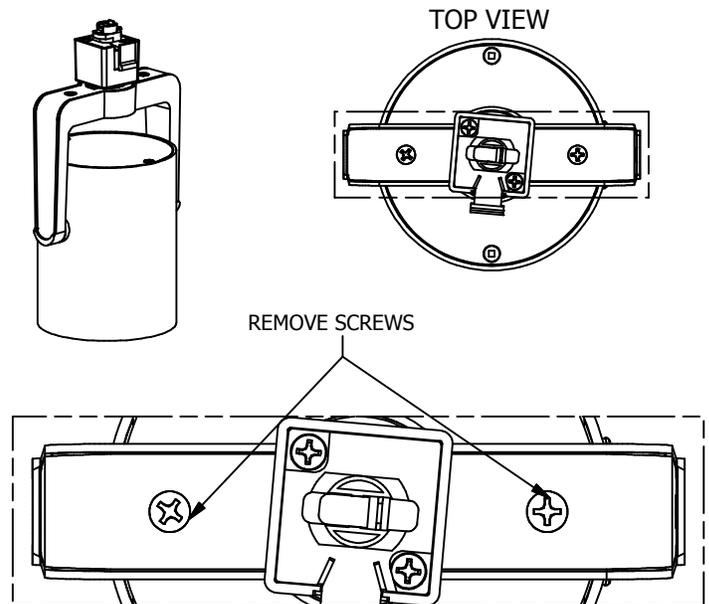


REMOVE & MAKE CONNECTIONS

- REMOVE EXISTING CONNECTIONS AND CONNECT NEW ADAPTER
- ENSURE FIXTURE IS GROUNDED
- REASSEMBLE IN REVERSE ORDER

WIRING

- L: BLACK**
- N: WHITE**
- G: GREEN**

GROUND FIXTURE USING SCREW AND TERMINAL FROM ADAPTER

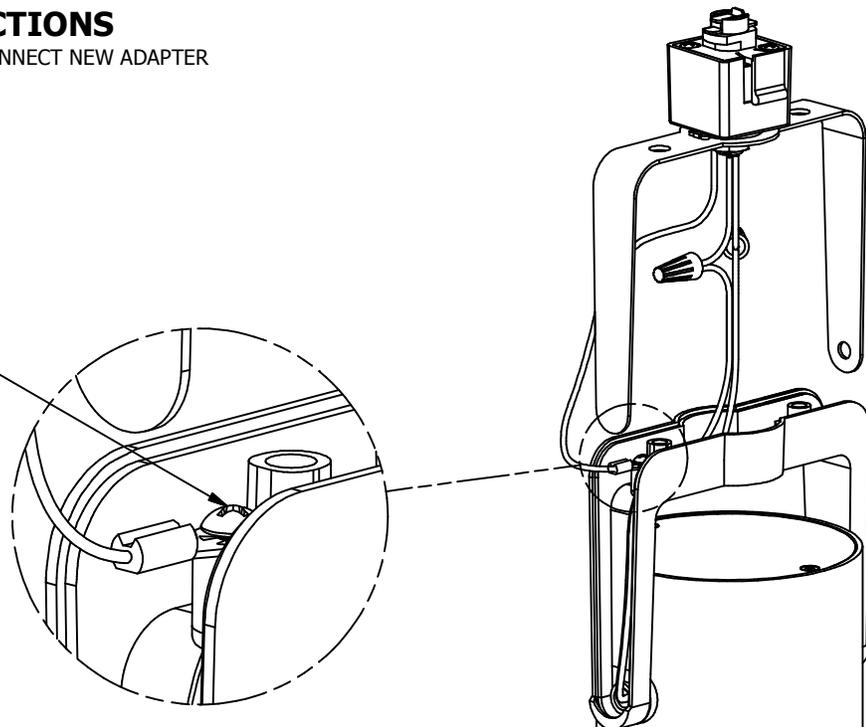

Amerlux, 178 Bauer Drive, Oakland, N.J. 07436, T: 973-882-5010, F: 973-882-2604 www.amerlux.com