



INSTRUCTION SHEET


AMERLUX REMOTE MOUNTED CURRENT LIMITING DEVICE WITH RIGID STEM SUSPENSION

689-0556

PAGE 1 OF 1


WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING. RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.

CONCRETE / HARD LID CEILING JUNCTION BOX MOUNTING

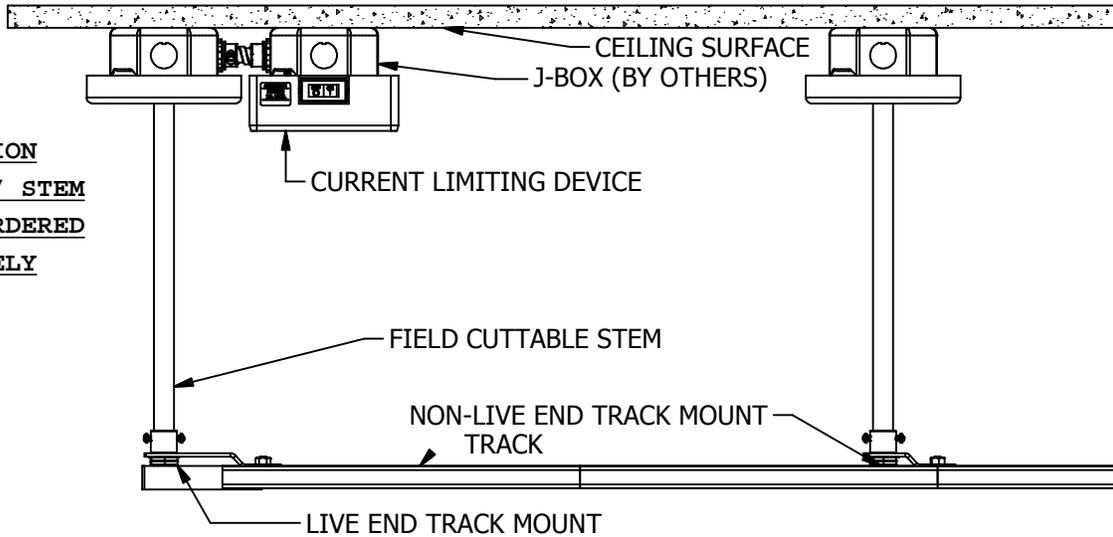


SUSPENSION CANOPY / STEM TO BE ORDERED SEPARATELY


GRID / DROP CEILING JUNCTION BOX MOUNTING

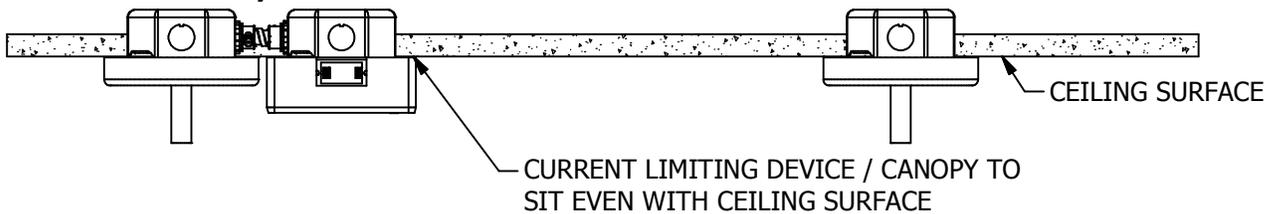

LIVE END TRACK MOUNT

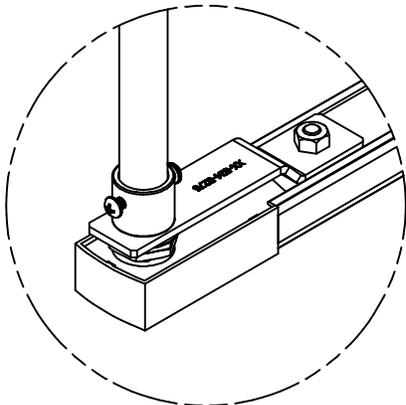

NON-LIVE END TRACK MOUNT

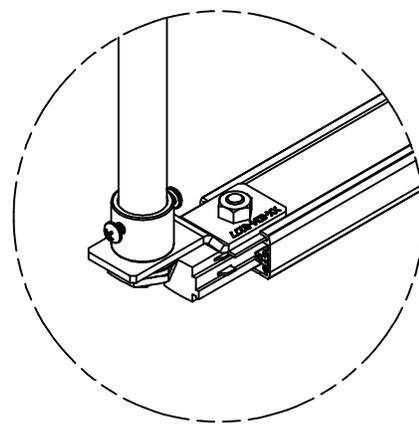

NOTE: GES TRACK SHOWN. SUSPENSION HARDWARE WILL VARY FOR OTHER TRACK TYPES


Amerlux, 178 Bauer Drive, Oakland, N.J. 07436, T: 973-882-5010, F: 973-882-2604 www.amerlux.com

WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING. RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.

1. ATTACH ACLREM BASE PLATE TO JUNCTION BOX

(HARDWARE SUPPLIED BY OTHERS)




4" OCTAGONAL JUNCTION BOX SUPPLIED BY OTHERS

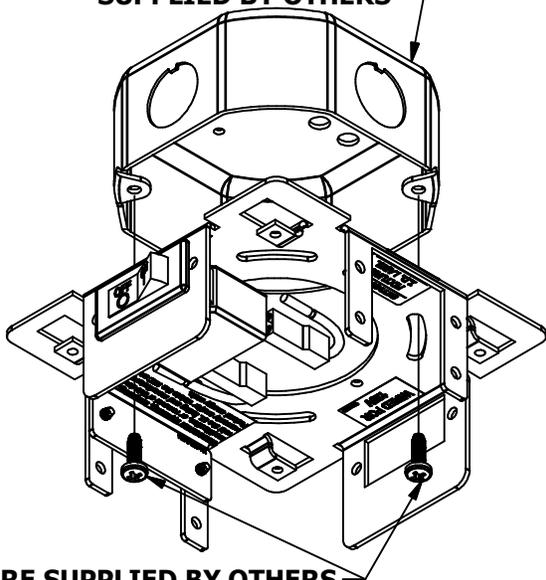

2. WIRE BREAKER(S)

618-0395 (12AWG 9" BLACK WIRE) IN FROM LINE

618-0396 (12AWG 9" RED WIRE) OUT TO LOAD

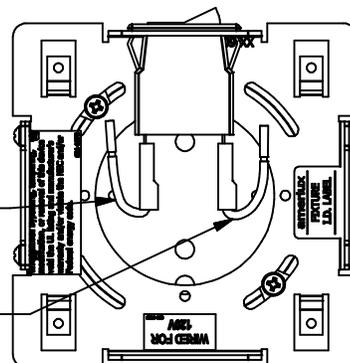

NOTE: LOAD AND LINE TERMINAL MARKINGS ON BREAKERS

HARDWARE SUPPLIED BY OTHERS

3. INSTALL COVER

USE SUPPLIED T10 DRIVER BIT TO TIGHTEN SUPPLIED M4 TAMPER RESISTANT SCREWS

